

Office of the District Fire Officer
Karnataka State Fire
and Emergency Services
Khanapur Road, Belagavi-590001



Phone : 0831-2429441
E-Mail : dfobgv@gmail.com

C.NO/327/NOC/DFO/BELAGAVI/2023

Date : 07/11/2023

To,
The Principal
Aarayans Fun School
Tejasha Educational & Research Foundation
CTS.No.4841/45B, 2nd Cross
Opp to Balika Hospital Main Road
Sadashiv Nagar
Tq & Dist - Belgavi

Sir,

Sub:- Issue of 'NOC' to "Aarayans Fun School Tejasha Educational & Research Foundation" CTS.No.4841/45B, 2nd Cross, Opp to Balika Hospital Main Road, Sadashiv Nagar, Tq & Dist - Belgavi.

Ref:- 1) C.NO/327/ADV/DFO/BELAGAVI/2023 Date: 12/09/2023

2) Applicant Letter No:AFS/ADM/Ltr-190/2023-24 Dated: 04/11/2023

*_*_*_*_*_*_*_*_*_*

With reference to the subject above cited, the premises to "Aarayans Fun School Tejasha Educational & Research Foundation" CTS.No.4841/45B, 2nd Cross, Opp to Balika Hospital Main Road, Sadashiv Nagar, Tq & Dist-Belgavi was inspected by the District Fire Officer, Belgavi on 07/11/2023 with respect to fire Prevention, Fire Fighting & Evacuation point of view for the purpose of issuing NOC and has submitted the details as under.

ANNEXURE-1

(Up to 14.99 mtrs. In height)

"GROUP-B Educational Buildings

NBC 2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory.)

A. Details of the Building/Premises.

01	Name and Address of the Applicant	The Principal Aarayans Fun School Tejasha Educational & Research Foundation CTS.No.4841/45B, 2 nd Cross Opp to Balika Hospital Main Road Sadashiv Nagar, Tq & Dist-Belgavi
02	Name and Address of the Premises	Aarayans Fun School Tejasha Educational & Research Foundation CTS.No.4841/45B, 2 nd Cross Opp to Balika Hospital Main Road Sadashiv Nagar, Tq & Dist-Belgavi
03.	Name and Address of the Building Owner	Shri Sanjay.B.Errannavar Sadashiv Nagar, Belgavi.
04.	Number of Building	01
05.	Number of Floors	G+1
06.	Floor-wise details of Occupancy:-	
	Ground Floor.	Class rooms-06 nos, Office-01 & Activity


(Signature)
07/11/23

		rooms-03 nos
	1 st floor	Class room-06 nos, Office & Staff room-01 & Computer room-01.
07.	Height of the building	06.80 mtr
08.	Site area	22 guntas
09.	Built-up area of each floor:-	
	Ground floor	1158.24 sq mtr
	1 st Floor	1158.24 sq mtr
10.	Total Built-up area	2316.48 sq mtr
11.	Surrounding properties:-	
	East	Residential Building
	West	Residential Building
	North	Road
	South	BIMS building
12.	Open Space all around the building	
	East	Nil
	West	Nil
	North	Nil
	South	50.00 mtr
	Allowed Setbacks (open space) should be maintained free from further obstruction/construction.	

B. On the inspection of this School/College premises, the following Fire Prevention, Fire Fighting and Evacuation Measures recommended are considered absolutely essential from fire safety point of view:-

fire safety point of view:-

Sl. No (01)	Details (02)	Existing (03)		Recommendations (04)
01.	Accessibility to the premises	The premises is easily accessible from the Northern side with the road of 09.00 mtr wide.		Adequate
02.	Number of Entrances	01 entrance of width 04.20 mtr wide on eastern side.		Adequate
03.	Number of Staircase	No of staircase	01 nos	Complied
		Width of the staircase	01.00 m	
		Width of threads	0.27 m	
		Height of risers	0.16 m	
		No of risers per flight	16 nos	
		Height of the hand drill.	0.80m	
04.	Portable Extinguishers	08 nos. of 4 Kg capacity ABC type extinguishers and 01 no. of 4.5 Kg capacity CO2 type extinguisher has been provided. All the extinguishers suggested are BIS markings and are located at an easily accessible position without obstructing the normal passage.		Complied
05.	Hose reel hose system	02 nos. of hose reel hose has been provided. The hose reel hose of		Complied

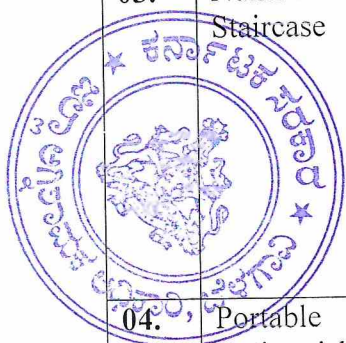

(Signature)
07/11/23

		min 19 mm size and of 30 mtrs length has been provided to reach the farthest point of each floor and shut off branch having a nozzle of 05 mm size. The hose reel hose is connected at staircase landing of the building.	
06.	At the terrace tank level with minimum pressure of 3.5 kg/cm2	The system has been connected to booster pump of 450 LPM capacity has been provided. Further the system also has been connected to alternative source of power supply.	Complied
07.	Diesel Generator	01 no.of 15 KVA capacity generator has been provided.	Complied
08.	Terrace Tank	01 no. each of 5000 Ltrs capacity overhead tank has been Provided.	Adequate
09.	Escape routes	Direction in which the students/teachers have to move in the event of emergency have been indicated in the corridor/passage as a guide during evacuation .	Complied.
10.	Fire Order (Fire safety plans)	A notice board indicating the action to be taken by the employees in case of any emergency have been displayed along with the telephone numbers of Belagavi Fire station i.e 0831-2429441, 101 & 080-22971550, 22971500, 22971600 the telephone nos nearest ambulance services and police station.	Complied
11.	No Smoking board	COPTA Sec-4 direction of No Smoking area, smoking here is an offence board is written in the English & Kannada both languages and is displayed inside the entry/exit of the each floor.	Complied
12.	Fire Siren	A fire siren has been installed in the premises to inform the students/teachers in case of a fire emergency and evacuate the area.	Complied
13.	Nominate One Fire Nodal Officer	Smt. Padmini Nitin Baki and Smt. Megha Patil Are nominated as fire nodal officers	Complied
14.	Fire Fighting Training	Not Imparted	At least 40% of the Teaching and non Teaching staff should be got trained in basic fire fighting at R.A.Mundkur Fire & Emergency Services Academy, Bannerughatta Road, Bangalore or Regional training centre.

B. B. B.
07/11/23

15.


Fire Precautionary Measures

- A :- Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory and electrical sum panel premises.
- B:- Accumulation of combustible waste in and around the premises should be avoided.
- C:- The Exit ways shall be always kept clear without any obstruction.
- D:- Liquefied petroleum gas should not be stored in the building.
- E:- The doors shall not be kept locked/ latched during working hours and shall be free from obstruction.
- F:- During the class hours the class room door shall not be locked from inside to out side.
- G:- As per Honorable Supreme Court order all teachers and staff shall be trained to handle safety equipments, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordination with the fire services department.

Under the above circumstance the Karnataka Fire & Emergency Services Department is issuing "NOC" to Aarayans Fun School Tejasha Educational & Research Foundation" CTS.No.4841/45B, 2nd Cross, Opp to Balika Hospital Main Road, Sadashiv Nagar, Tq & Dist - Belgavi. As they have complied all the recommendations as per reference 1. The staff should get trained in the basic fire fighting at Training Centre R.A.Mundkur Fire & Emergency Services Academy, Bannerughatta Road, Bangalore or Regional training centre Hubballi.

This "NOC" is valid for only one year from the date of issue and is renewable.

Yours Faithfully

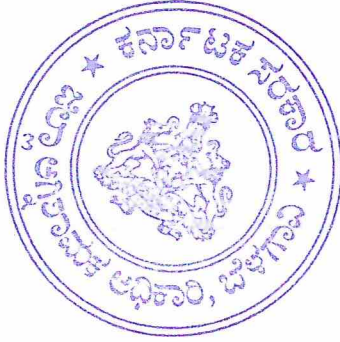

Bide 07/11/23
District Fire Officer
Karnataka State Fire And Emergency Services
Belagavi-01.